

EXHIBIT P

**WATER WELL
IMPROVEMENTS**



DR.

SAILFISH

PROPERTY LINE


PROPERTY LINE

PROPERTY LINE

PROPERTY LINE

BLUEGILL

DR.

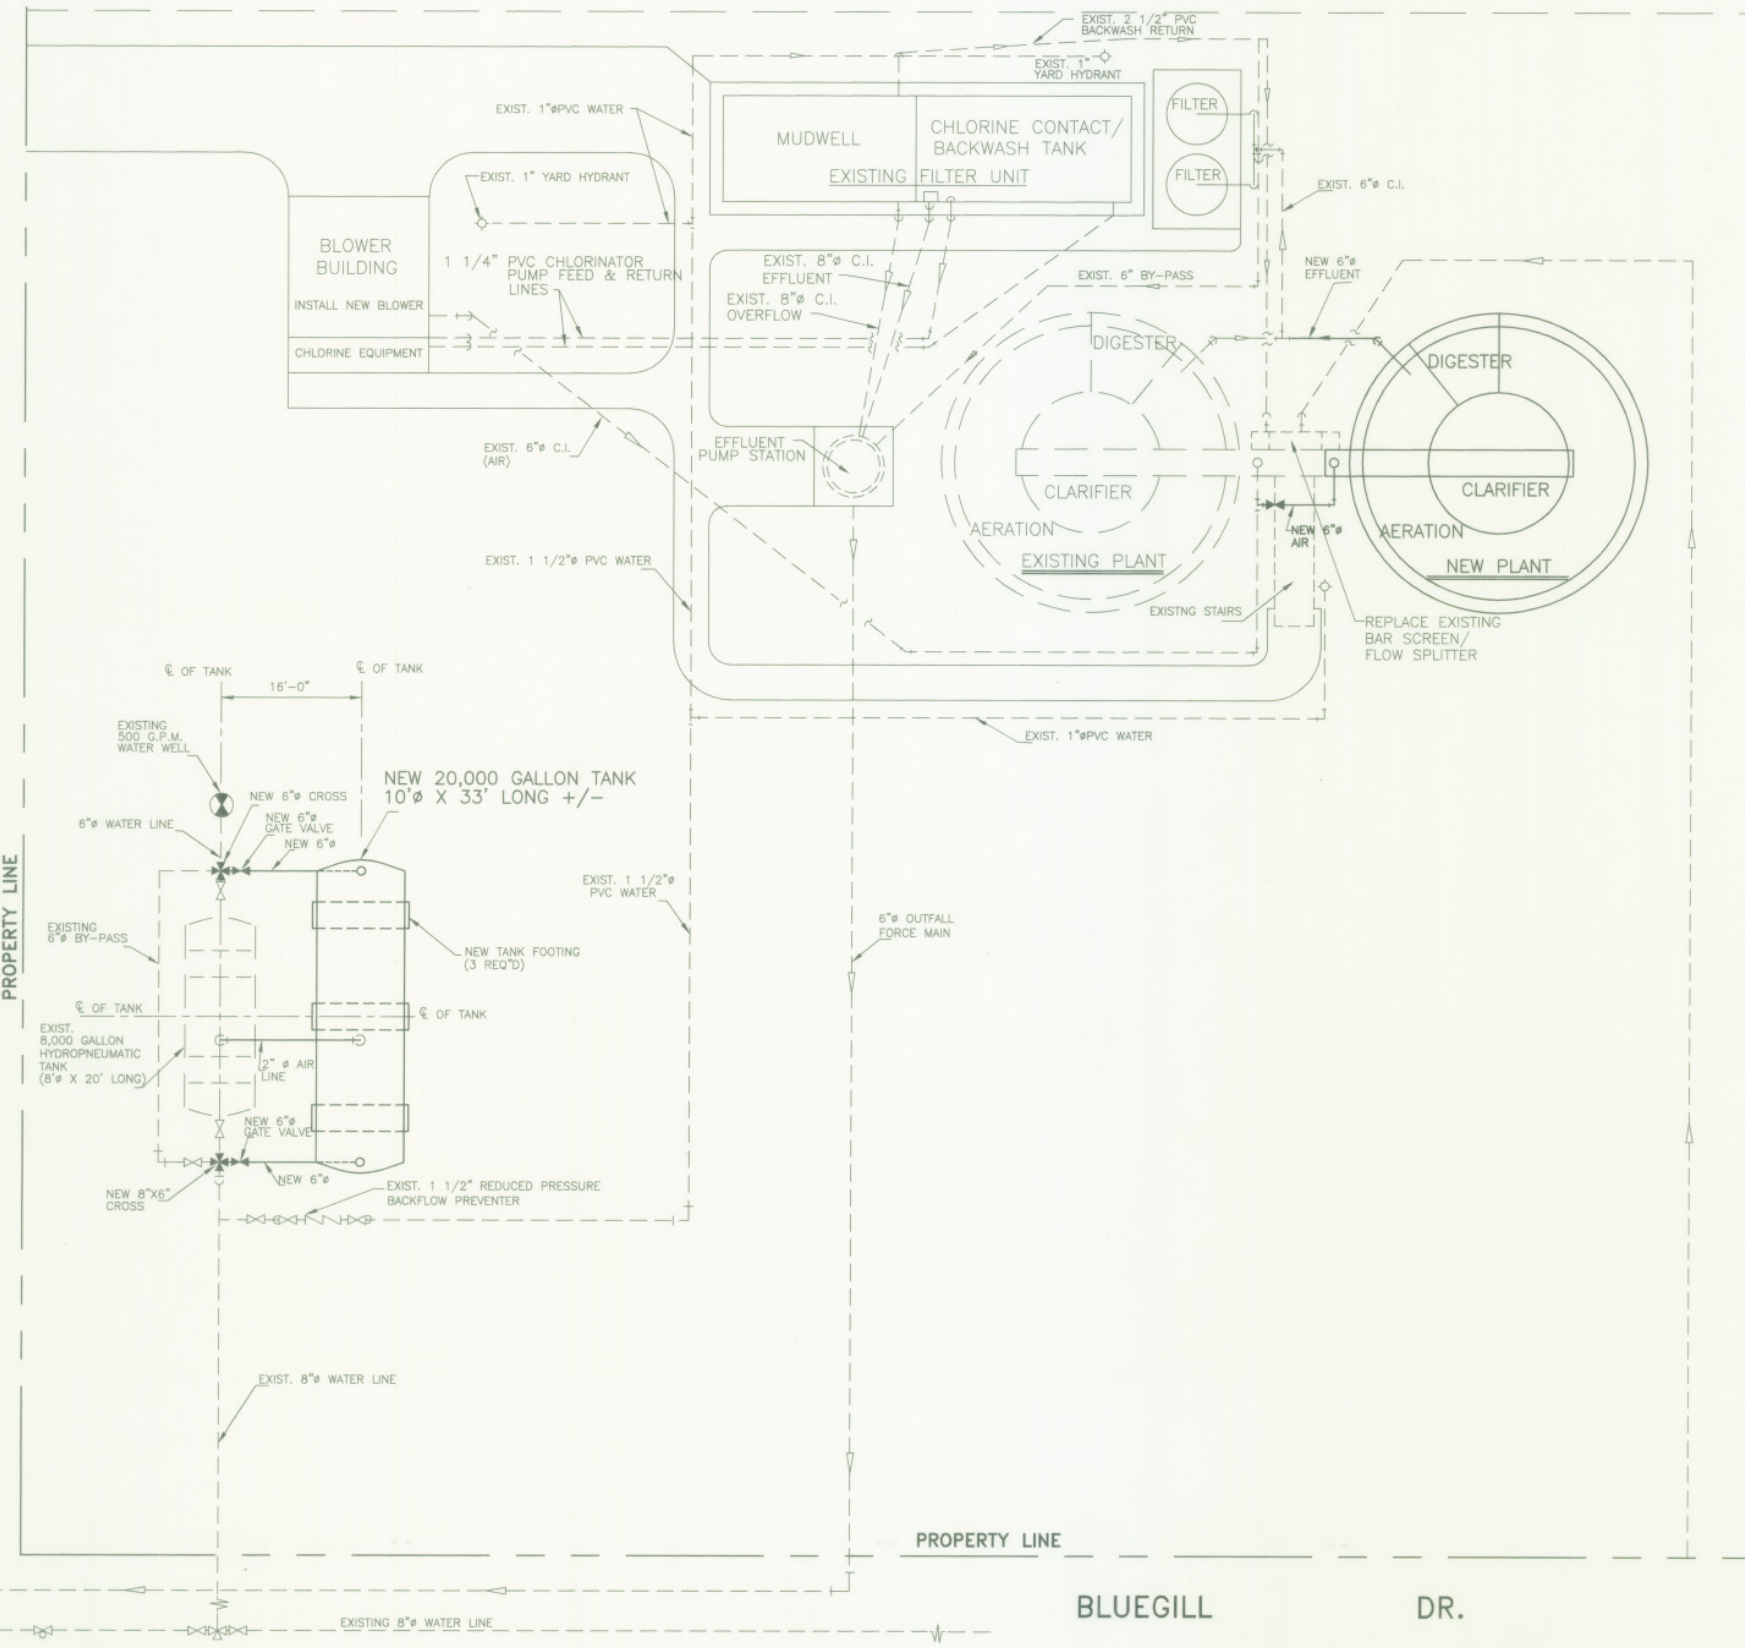

YARD PIPING NOTES

1. UNLESS INDICATED OTHERWISE, ABOVE-GROUND PIPING 4" Ø AND LARGER SHALL BE CAST IRON WITH FLANGED JOINTS.
2. UNLESS INDICATED OTHERWISE, ALL BELOW-GROUND PIPING 4" Ø AND LARGER SHALL HAVE MECHANICAL JOINTS OR RUBBER GASKET PUSH-ON JOINTS.
3. BELOW GRADE EFFLUENT AND WASTE SLUDGE LINES SHALL BE PVC SDR-21 WITH MECHANICAL JOINT FITTINGS.
4. UNDERGROUND PIPING SHALL HAVE 30" MINIMUM COVER.
5. CONTRACTOR SHALL PROVIDE NECESSARY BENDS AND FITTINGS TO AVOID CONFLICTS.
6. LOCATION OF EXISTING PIPING IS APPROXIMATE. CONTRACTOR TO LOCATE SAME AND AVOID CONFLICTS.
7. CONTRACTOR SHALL FURNISH AN AS-BUILT PLAN SHOWING THE LOCATION OF ALL UNDERGROUND PIPING.



THE RIGOLETS PHASE III TREATMENT PLANT AND WATER WELL IMPROVEMENTS ST. TAMMANY PARISH, LA.		
SITE PLAN AND YARD PIPING		
KREBS, LaSALLE, LeMIEUX CONSULTANTS, INC. ENGINEERING • PLANNING • SURVEYING • HYDROLOGY • ENVIRONMENTAL 3013 27TH ST. METAIRIE, LA. 70002 (504)837-9470 2107 N. CAUSEWAY BLVD., SUITE F MANDEVILLE, LA. 70448 (504)624-5125		
DATE: JULY 5, 2001	SCALE: 1"=10'	DRAWING NO. 2 OF 6
DESIGNED BY: M.M.H.	DRAWN BY: A.F.	
JOB NO.401-0043	CHECK BY:	APPROVED BY: