

Exhibit L. Colyell Business Park Potable Water Infrastructure Map

Colyell Business Park Potable Water Infrastructure Map

Colyell Business Park
Livingston Parish, LA

BRAC



LEGEND

- Site Boundary
- Elevated water tank
- Town of Livingston Potable Water Infrastructure**
- Existing 6-inch Water Line
- Existing 12-inch Water Line
- Existing Roadway**
- Urban State
- Local




P:\212161\Sites Under Contract\025 - Colyell Business Park\CADD\GIS Templates\GIS\Exhibit L - Site Potable Water Infrastructure Location Map.mxd



Date: 12/3/2019
Project Number: 212161
Drawn By: BNF
Checked By: EEB

General Notes:
 1. No attempt has been made by CSRS, Inc. to verify site boundary, title, actual legal ownership, deed restrictions, servitudes, easements, or other burdens on the property, other than that furnished by the client or his representative.
 2. Transportation data from 2013 TIGER datasets via U.S. Census Bureau at [ftp://ftp2.census.gov/geo/tiger/TIGER2013](http://ftp2.census.gov/geo/tiger/TIGER2013).
 3. Utility information from visual inspection and/or the individual utility operators. Exact field location has not been determined by survey. The lines shown are an approximate representation only and may have been offset for depiction purposes.
 4. 2015 aerial imagery from USDA-APFO National Agricultural Inventory Project (NAIP) and may not reflect current ground conditions.

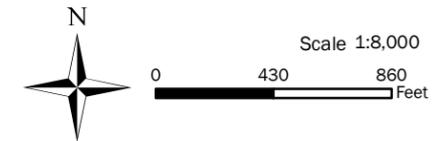


Water Utility Provider Questionnaire (page 1 of 2)

Site Name: Colyell Business park
CSRS Project ID: 212161



Site Map 1

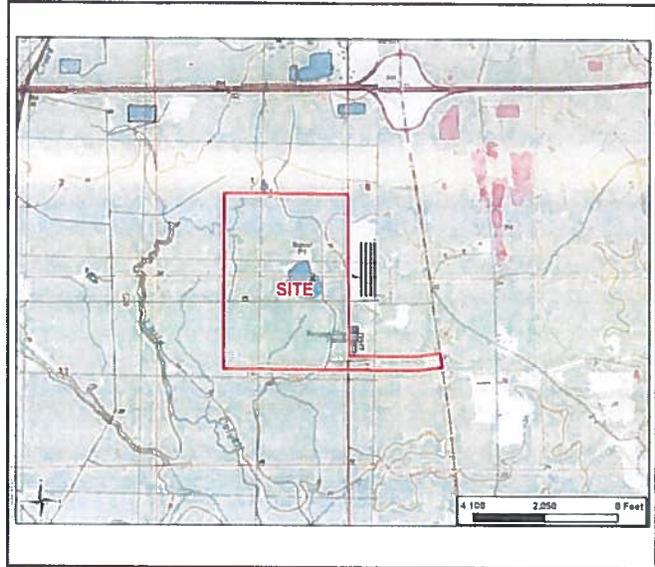

Site Map 2

Date: **November 26, 2019**
Provider Name: **Town of Livingston**
Address: **P.O. Box 430**
City: **Livingston**
State: **Louisiana**

Zip Code: **70754**
Name: **Nathan Corkern**
Phone: **225-978-3695**
Email: **ncorkern@townoflivingston.com**
Title: **Director of Public Works**

Is potable or process water currently available at this site?
 Yes No

What is the distance (feet) to the nearest potable or process water distribution line to service this site?
(feet) **500'**

What is the size (inches in diameter) of the nearest line?
6" Main (inches)

What are the pressures of the water line at or nearest to this site? Static:

Residual: **50 PSI**

Source of potable or process water (lake, well, other source) **(2) Wells**

0.55 MGD Storage
3.6 MGD Production

What is the total potable/process capacity of the existing water system in millions of gallons per day (MGD)?

What is the current average daily use of the existing water system in millions of gallons per day (MGD)? **0.6 MGD**

What is the peak demand on the existing water system in millions of gallons per day (MGD)? **2,100 MGD**

What is the excess capacity of the existing water system in millions of gallons per day (MGD)? **3.0 MGD**

Capacity of closest elevated potable water storage tank (gallons): **300,000 gallons**

Distance to closest elevated potable water storage tank (miles): **100' See Map**

Distance to appropriate booster station (miles): **N/A**

Is or will there be adequate pressure and flow at site to combat fires? Yes No

Is a plan underway to improve services at or near this site within the next year? If so, please provide anticipated upgrades, location, and time for implementation.


There is NO plan too improve the service at or near this site within the next year.

Water Utility Provider Questionnaire (page 2 of 2)

Site Name: Colyell Business park

CSRS Project ID: 212161

Please provide a map of existing utilities near the site. (click in area to insert image)

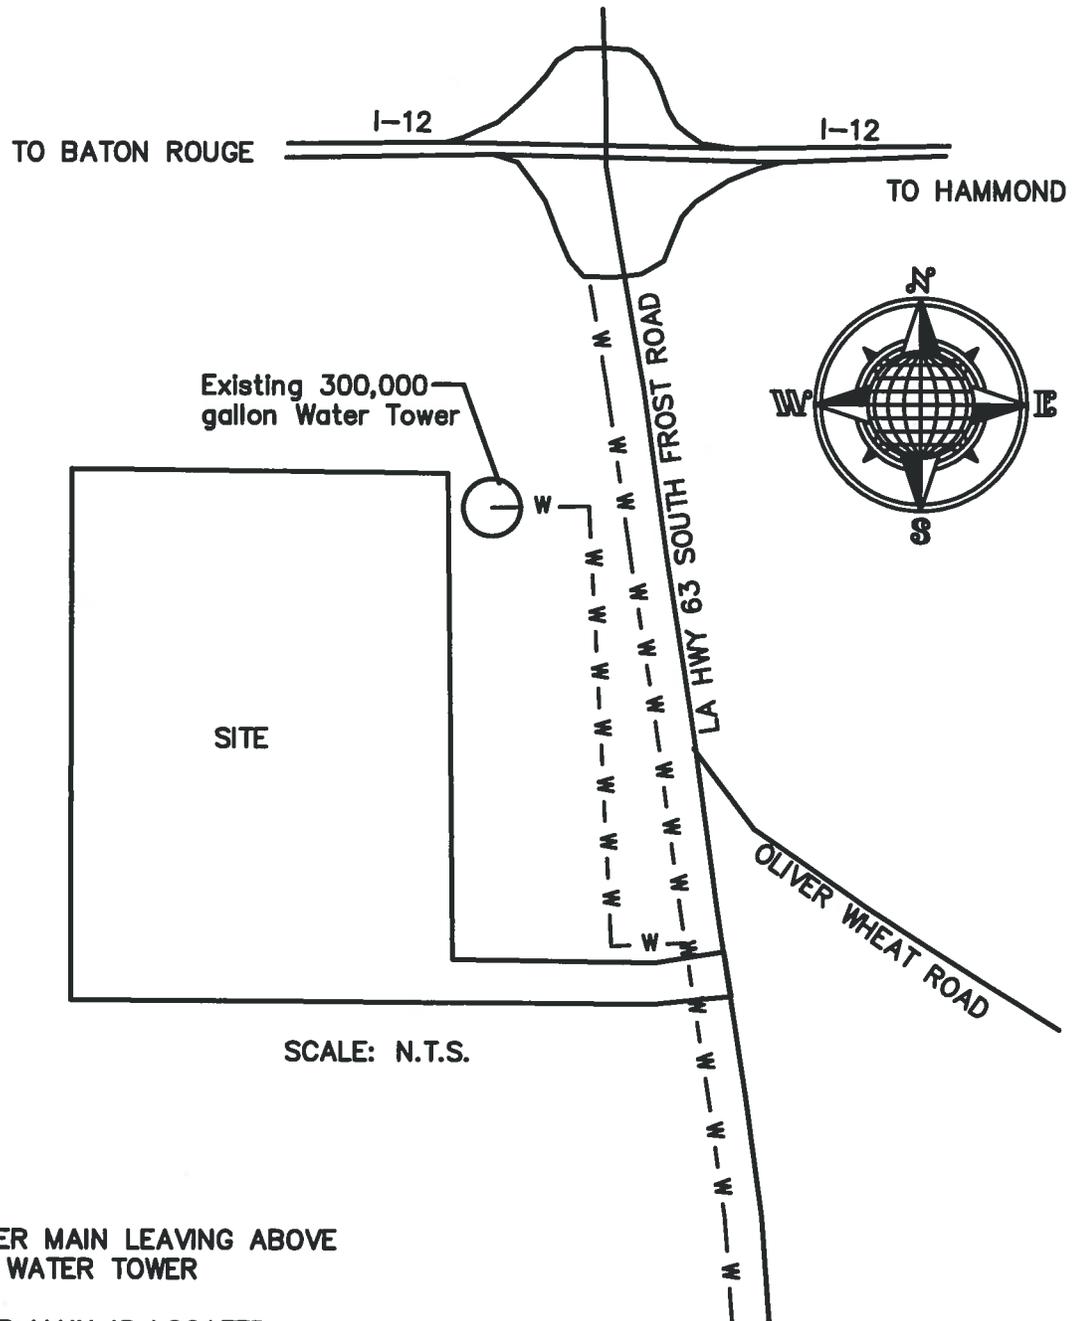

SCALE: N.T.S.

- 1) 12" WATER MAIN LEAVING ABOVE GROUND WATER TOWER
- 2) 6" WATER MAIN IS LOCATED APPROXIMATELY 55' WEST OF THE CENTERLINE OF LA HWY 63 SOUTH FROST ROAD

[Submit Form](#)