

Exhibit N. Acadiana Regional Airport P4 Site Electrical Distribution Infrastructure Map

Acadiana Regional Airport P4 Site Electrical Distribution Infrastructure Map

Acadiana Regional
Airport P4 Site
Iberia Parish, LA

One Acadiana




LEGEND

- Site Boundary
- Existing 13.2 kV Cleco Power, LLC Electrical Line
- Existing 34.5 kV Cleco Power, LLC Electrical Line
- Distribution Station
- Existing Roadway
 - Urban State Highway
 - Rural State Highway
 - Local Roads
 - Stream




Date:	10/4/2019
Project Number:	214002
Drawn By:	BNF
Checked By:	EEB

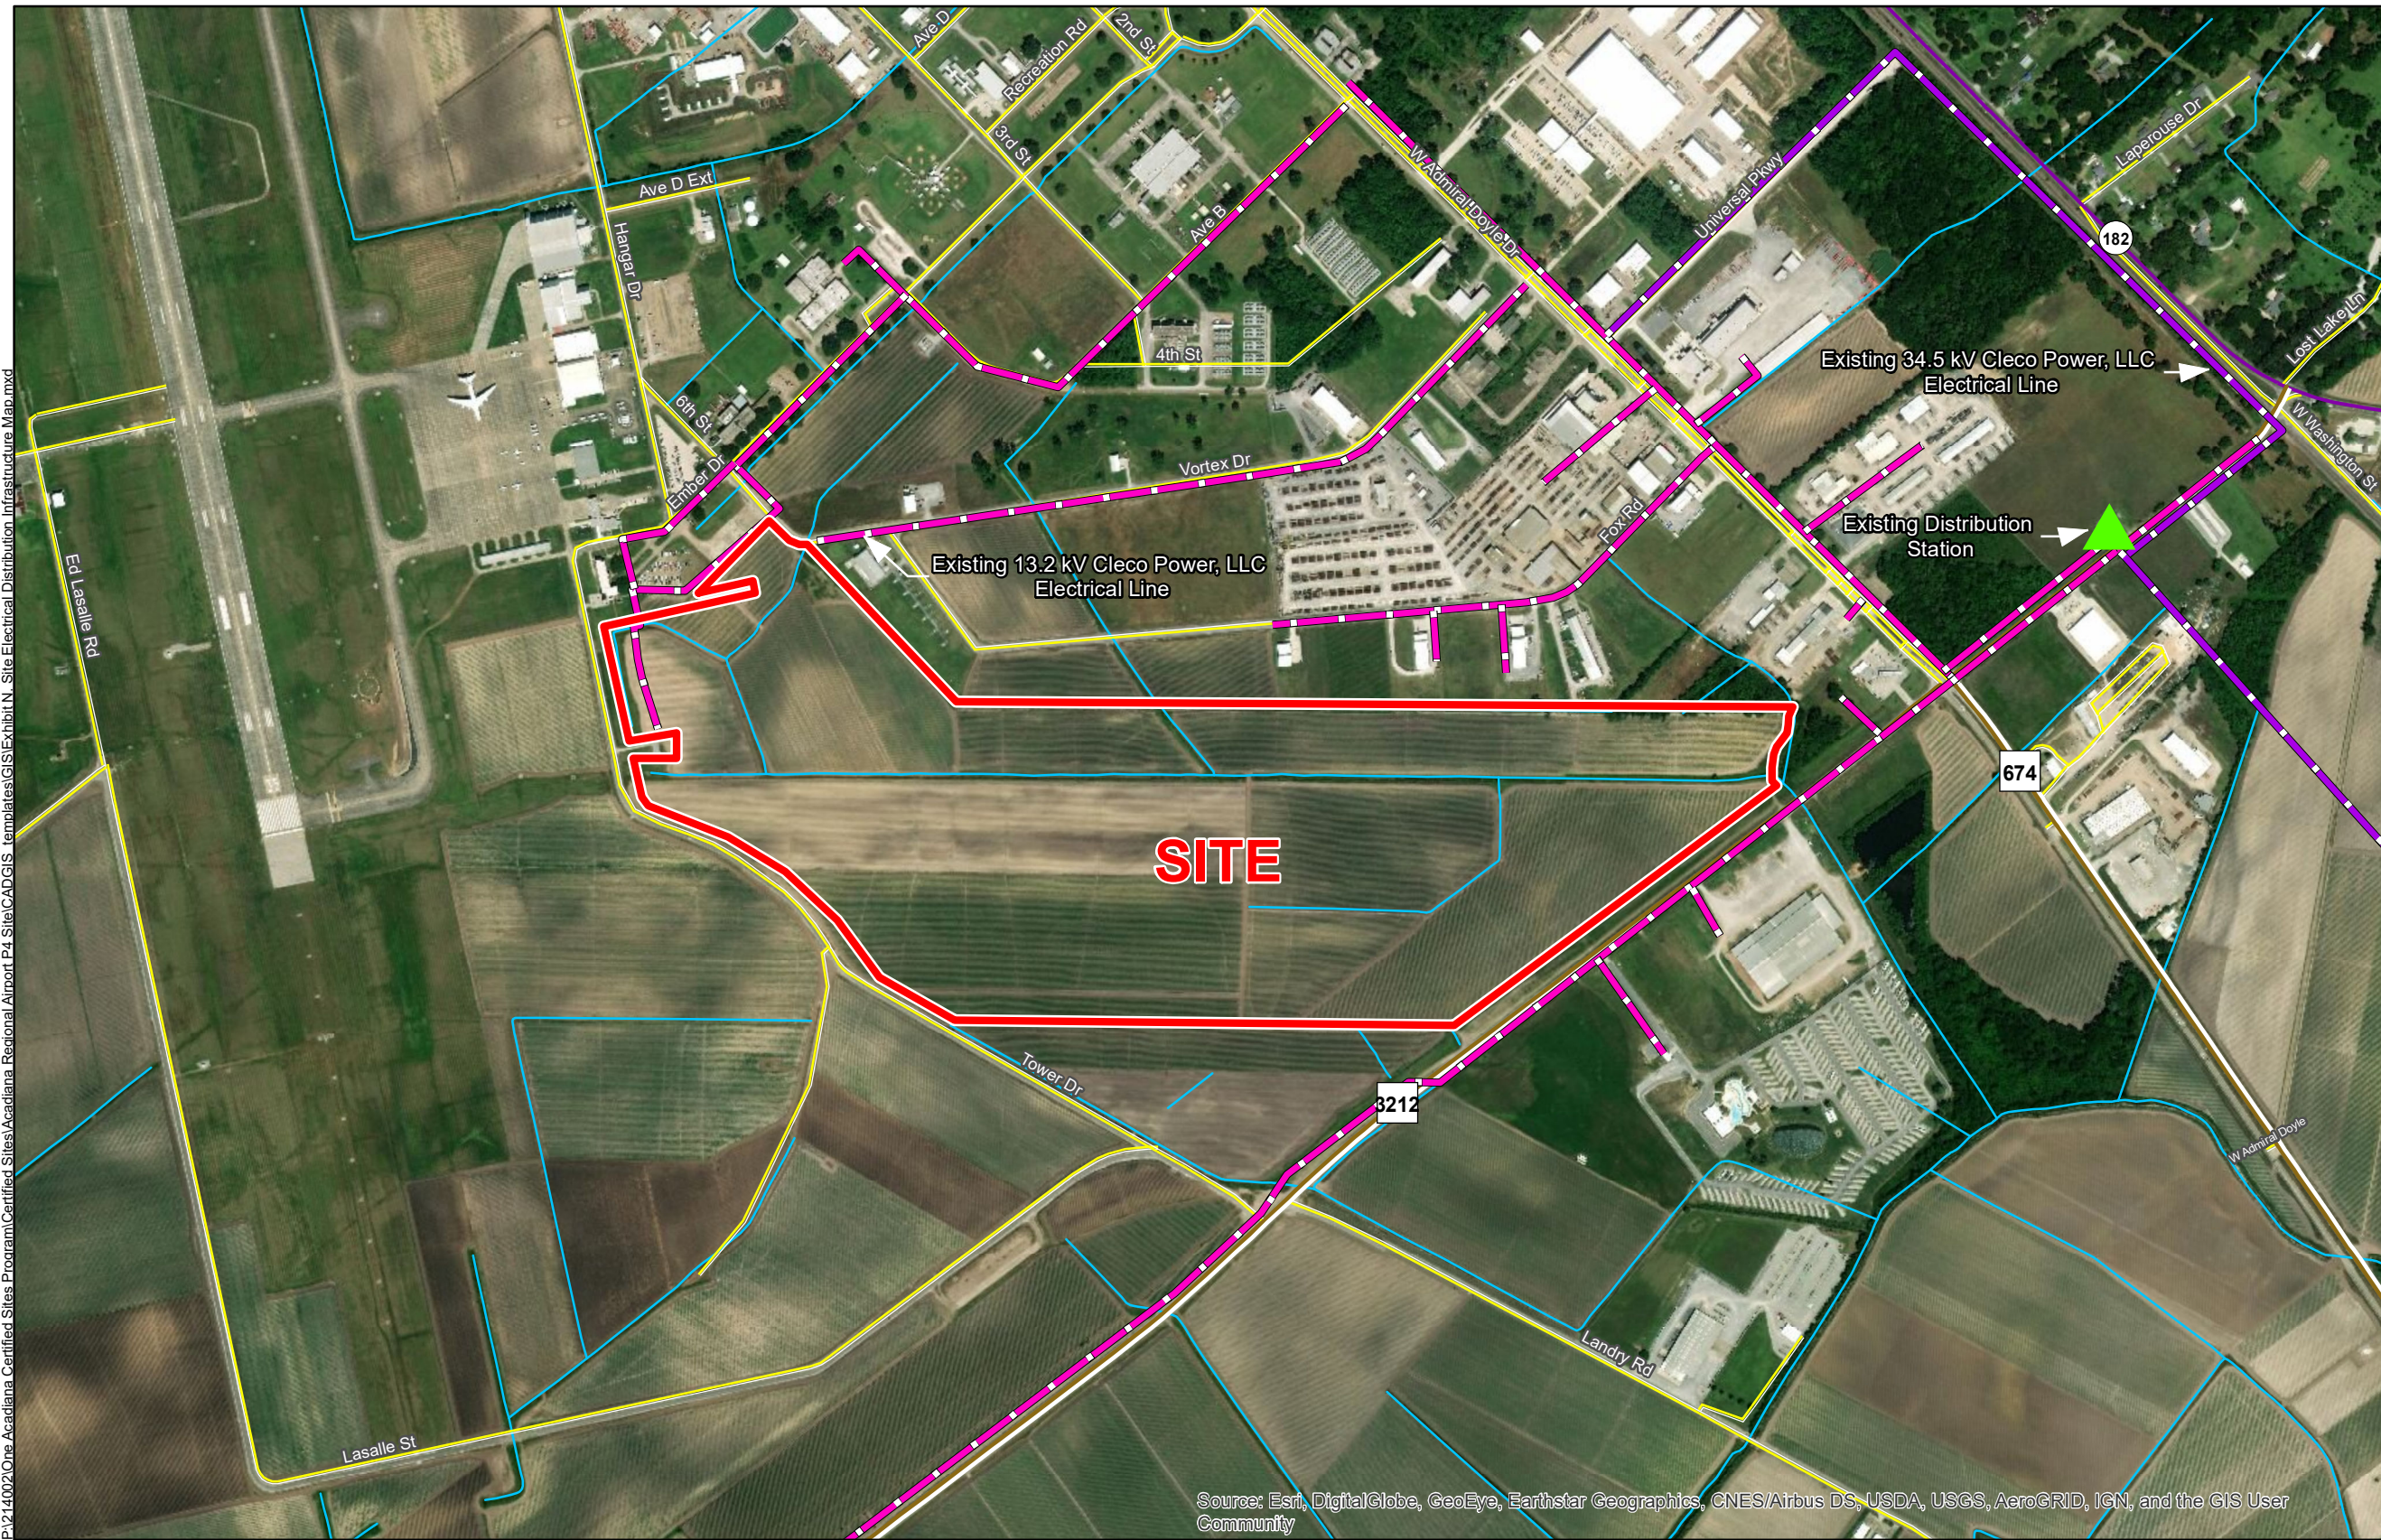

General Notes:

1. No attempt has been made by CSRS, Inc. to verify site boundary, title, actual legal ownership, deed restrictions, servitudes, easements, or other burdens on the property, other than that furnished by the client or his representative.
2. Transportation data from 2013 TIGER datasets via U.S. Census Bureau at <ftp://ftp2.census.gov/geo/tiger/TIGER2013>.
3. Utility information from visual inspection and/or the individual utility operators. Exact field location has not been determined by survey. The lines shown are an approximate representation only and may have been offset for depiction purposes.
4. 2015 aerial imagery from USDA-APFO National Agricultural Inventory Project (NAIP) and may not reflect current ground conditions.

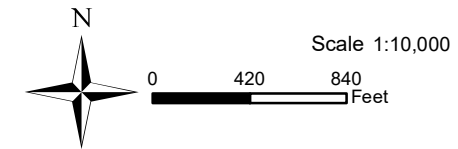

P:\214002\One Acadiana Certified Sites\Acadiana Regional Airport P4 Site\CAD\GIS templates\GIS\Exhibit N_Site Electrical Distribution Infrastructure Map.mxd

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

Electric Utility Provider Questionnaire

(page 1 of 2)

Site Name:

CSRS Project ID:

Site Map 1

Site Map 2

Date (mm/dd/yyyy):

Provider Name:

Address:

City:

State:

Zip Code:

Name:

Phone:

Email:

Title:

Is electric distribution currently available at this site?

Yes

No

Is 3-Phase service currently available to this site?

Yes

No

Is dual feed currently available?

Yes

No

What is the size of the nearest distribution line and distance (feet) to the site?

Size (kV)

Distance

If 3-phase is not available at the site, what is the size (kV) of and distance (feet) to the nearest three-phase line?

Size (kV)

Distance

What is the size of and distance (miles) to the nearest transmission line with a 69kV or greater?

Size (kV)

Distance

What is the distance (miles) to the nearest substation to serve the site?

Distance

Name

What is the distance (miles) to the next closest substation to serve the site?

Distance

Name

What is the current Peak Load capacity available to this site (MW)? If no load information is available, please provide minimum MW currently available to the site.

Peak (MW)

Electric Utility Provider Questionnaire

(page 2 of 2)

Site Name:

CSRS Project ID:

Is a plan underway to improve services at or near this site within the next year? If so, please provide anticipated upgrades, location, and time for implementation.

Please provide a map of existing electric utility assets near site. (click in area to insert image)